


NOTE:

REFER TO DWG. NO. 2 AND SECTION 02605 OF THE SPECIFICATIONS FOR MANHOLE CONSTRUCTION DETAILS REFER TO DWG.#1 FOR PLAN VIEW

FOR DETAILS REFER TO DWG. NOS.1,2,&2A AND SECTION 02605(3.08)

MANHOLE LID ASSEMBLY REFER TO DWG. NO.4

FINISHED GRADE

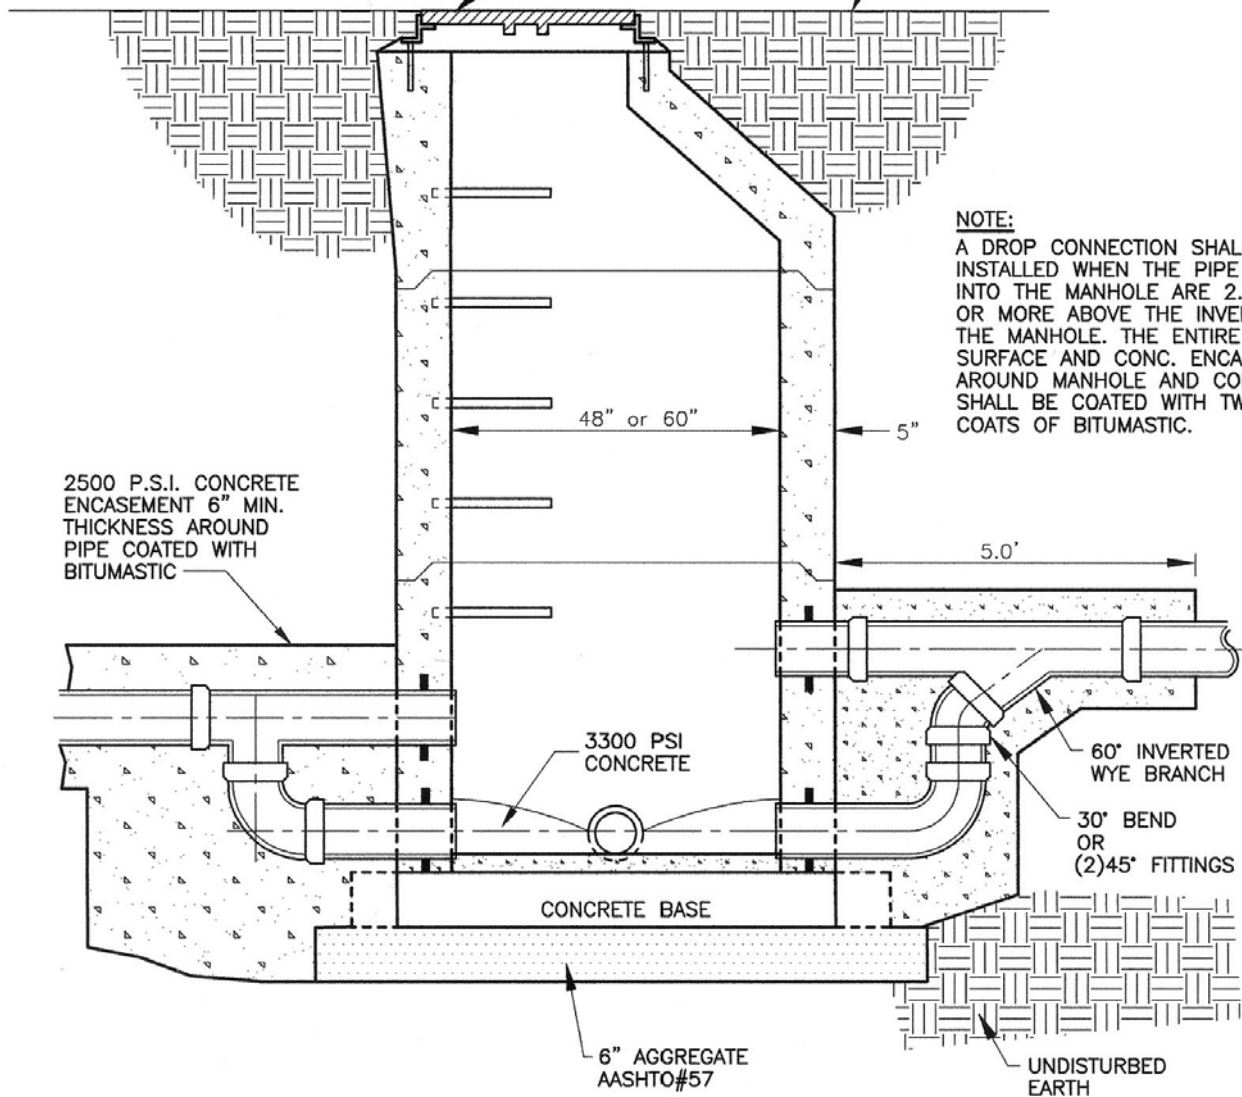

NOTE:

A DROP CONNECTION SHALL BE INSTALLED WHEN THE PIPE INVERTS INTO THE MANHOLE ARE 2.0 FEET OR MORE ABOVE THE INVERT OUT OF THE MANHOLE. THE ENTIRE OUTER SURFACE AND CONC. ENCASEMENT AROUND MANHOLE AND CONNECTIONS SHALL BE COATED WITH TWO COATS OF BITUMASTIC.

2500 P.S.I. CONCRETE ENCASEMENT 6" MIN. THICKNESS AROUND PIPE COATED WITH BITUMASTIC

3300 PSI CONCRETE

CONCRETE BASE

6" AGGREGATE AASHTO#57

60° INVERTED WYE BRANCH

30° BEND OR (2)45° FITTINGS

UNDISTURBED EARTH

STANDARD DETAIL

TYPICAL DROP MANHOLE

SECTION B-B

PRECAST BASE AND WALL SECTIONS

NOT TO SCALE

06/01

DWG. NO.3