


**NOTES:**

1. WHEN REQUIRED, VENTILATION IN THE WET WELL WILL BE PROVIDED BY A PORTABLE BLOWER WHICH IS OWNED BY PATTON FERGUSON JOINT AUTHORITY. BLOWER IS CAPABLE OF PROVIDING 30 AIR CHANGES PER HOUR.
2. BUBBLER LINE GUARD (2-3"x3") FURNISHED BY CONTRACTOR AND CUT TO REQUIRED LENGTH AT INSTALLATION.

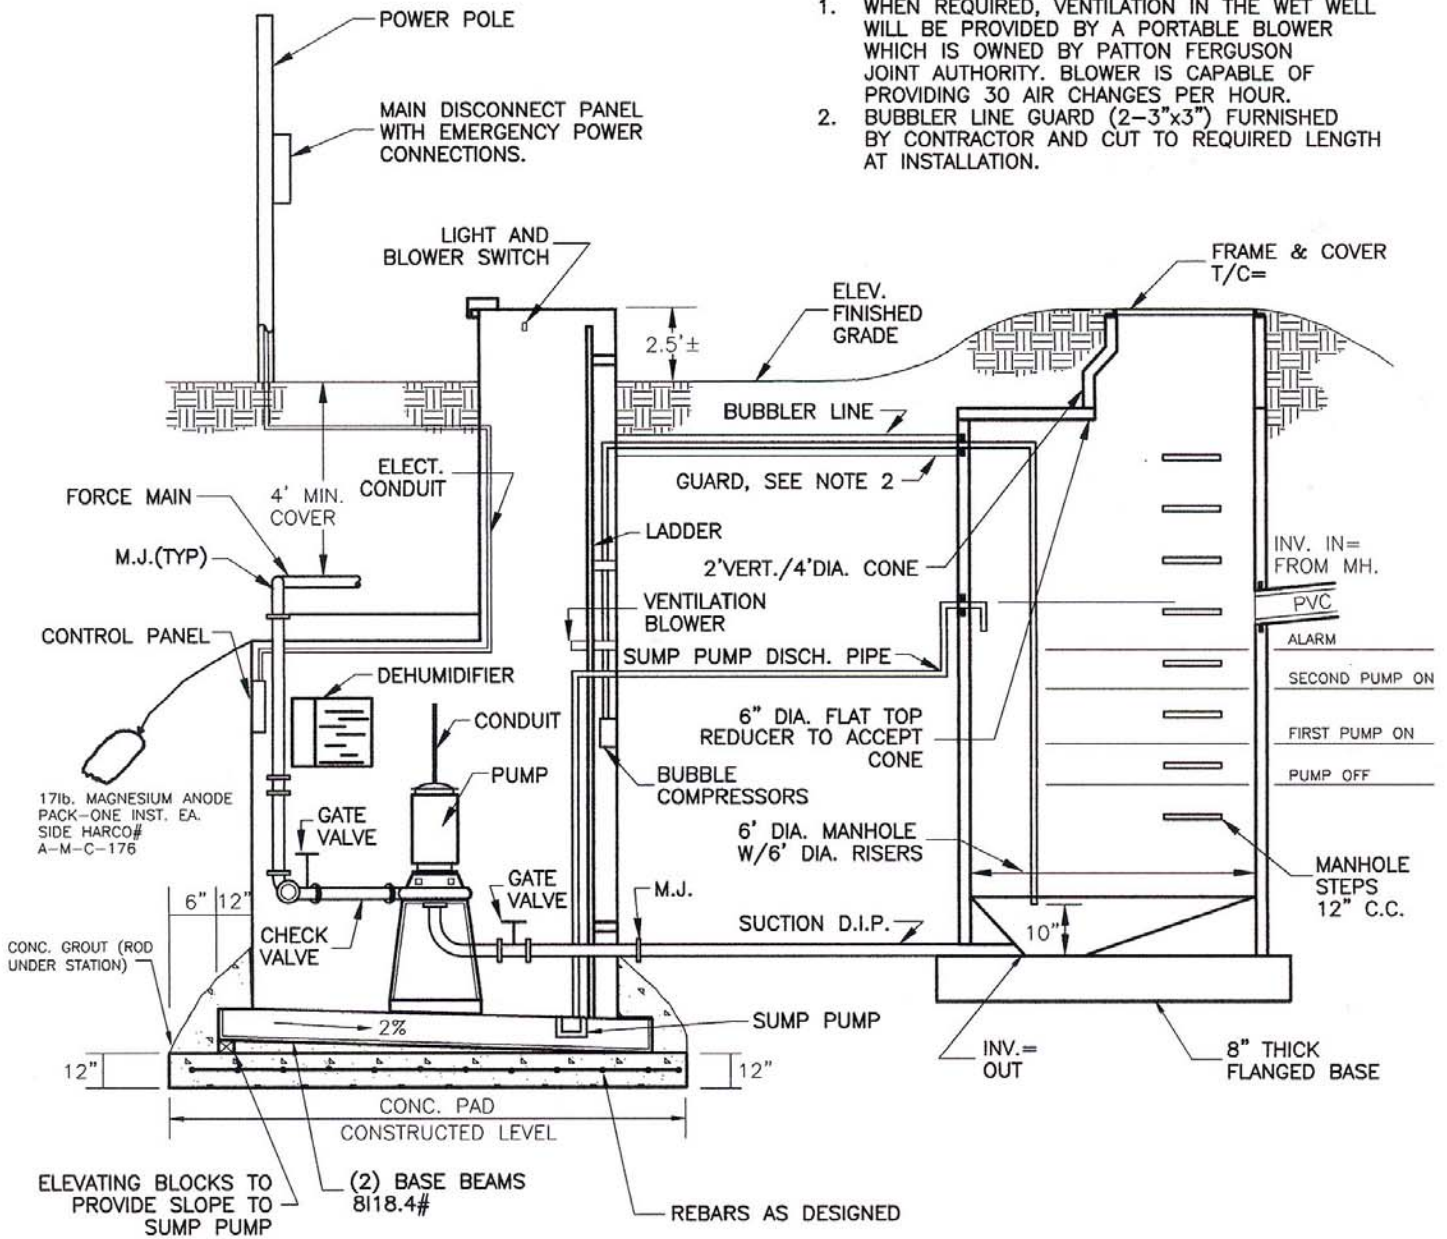

**STANDARD DETAIL**

**PUMP STATION  
GENERAL SCHEMATICS**

NOT TO SCALE | 06/01 | DWG. NO.13